


- CONCRETE SERVICE CONNECTIONS TO NEW SANITARYWARE, AS SETTING ON LAUNDRY IN ACCORDANCE WITH H14M401
- ALL PIPERWORK SHALL BE COVERED TO BS EN 1057
- ALL PIPERWORK SHALL BE THERMALLY INSULATED IN 50MM PHENOLIC FOAM AND SHALL BE IDENTIFIED AS PER BS 7790
- ALL FITTINGS MUST BE MANUFACTURED BY ORANGE OF HANDELSSETZ
- ALL FITTINGS MUST BE PROX CERTIFIED
- THE CONTRACTOR MUST OBTAIN A COPY OF THE CLIENT'S WATER SURETY PLAN TO ENSURE THAT THEY UNDERSTAND THE REQUIREMENTS OF THIS SPECIFICATION AND ALSO, INCLUDING THE INCREASED FINANCIAL CONSEQUENCES OF THIS SPECIFICATION DEAD LOSS, INCLUDING THE RELEASED PIPERWORK ON THE HOT WATER CIRCULATION SYSTEMS SHALL BE LIMITED TO 15 LITRES OR 3 METRES, WHICHEVER IS THE LOWER VALUE. NO OTHER LOSS DEAD LOSSES TO BE INTRODUCED TO THE SYSTEM AS PART OF THE WORKS
- ANY DEAD LOSS DEAD LOSS IDENTIFIED DURING SHIPOUT TO BE STRIPPED BACK TO SOURCE
- THE CONTRACTOR MUST ALLOW FOR:
- ALL NECESSARY STABILISATION, FLUSHING, FILTING AND LEAKING OF ALL SERVICES TO BE POTABLE QUALITY.
- ALL TESTING, INTERFERING HYDRAULIC PRESSURE TESTS, BLANKING, VENTING AND COMMISSIONING, AND LABORATORY TESTING TO PROVE WATER QUALITY IS NOT FOR THE IDENTIFIED PURPOSE.
- ALL PRIMARY AND SECONDARY SUPPORT SYSTEMS TO INSTALL THE SERVICES

TESTING & COMMISSIONING:

- THE CONTRACTOR SHALL ENSURE THAT ACCURATE RECORDS ARE TAKEN FOR ALL CHECKS AND MEASUREMENTS UNDERTAKEN WITHIN THE COMMISSIONING SCOPE OF WORKS.
- THE MECHANICAL CONTRACTOR SHALL UNDERTAKE HYDRAULIC AND/OR PNEUMATIC PRESSURE TESTING OF PIPEWORK
- THE MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR ENSURING THAT ALL PIPEWORK IS FLUSHED AND CHEMICALLY CLEANED BY OTHERS AS PER PD 836468

TM	FEED	TEAGER ISSUE	ML	PT
REV	DATE	DESCRIPTION	BY	VE

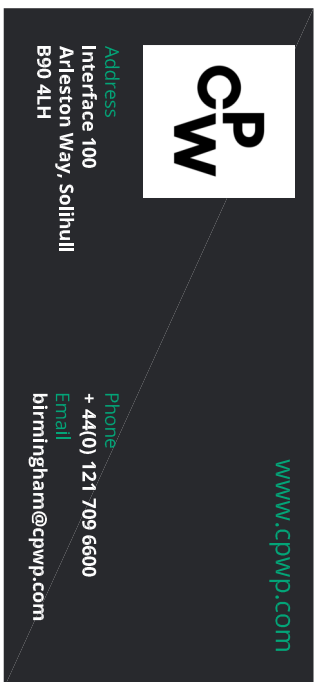

STAGE 4

TENDER ISSUE

Status

Client

 **Bedfordshire Hospitals**
NHS Foundation Trust

Project
PROPOSED CONSULTATION ROOMS
WITHIN EXISTING CHAUL END COMMUNITY CENTRE
(FIRST FLOOR)

PROPOSED DOMESTIC SERVICES LAYOUT

Scale (A1)	Date	By	Ve					
1:50	NOV21	NL	PT					
Proj ID	Organizer	Volume	Level	Type	Rate	Number	Subtype	Reason
210561	CPW	XX	01	DR	M	12061	D2	T01

210581-CPW-XX-01-DR-M-12201 D2 T01

Linked Files