## Legend

- Single Phase Socket Twin Switched
- Fused Connection Unit Unswitched
- Fused Connection Unit Switched
- Socket Outlet Unswitched
- Data Socket Double Data (RJ45)
- Proximity Access Card Reader
- Request To Exit Button

Underfloor Power Track

DA Disabled Alarm Pull Cord

DA Disabled Indicator with Reset and Lamp

SEC Security for CCTV camera RTE Request to exit

PR Proximity card reader


Two compartment DADO trunking FCU Fan coil unit


RAP Refuge Alarm Panel with power supply

External Access control reader to operate Vehicle gate and pedestrian gate

## Abbreviations

- CL Cleaners Socket
- HL High Level FR Fridge
- CR Cooker
- HW Hot Water
- DW Dish Washer



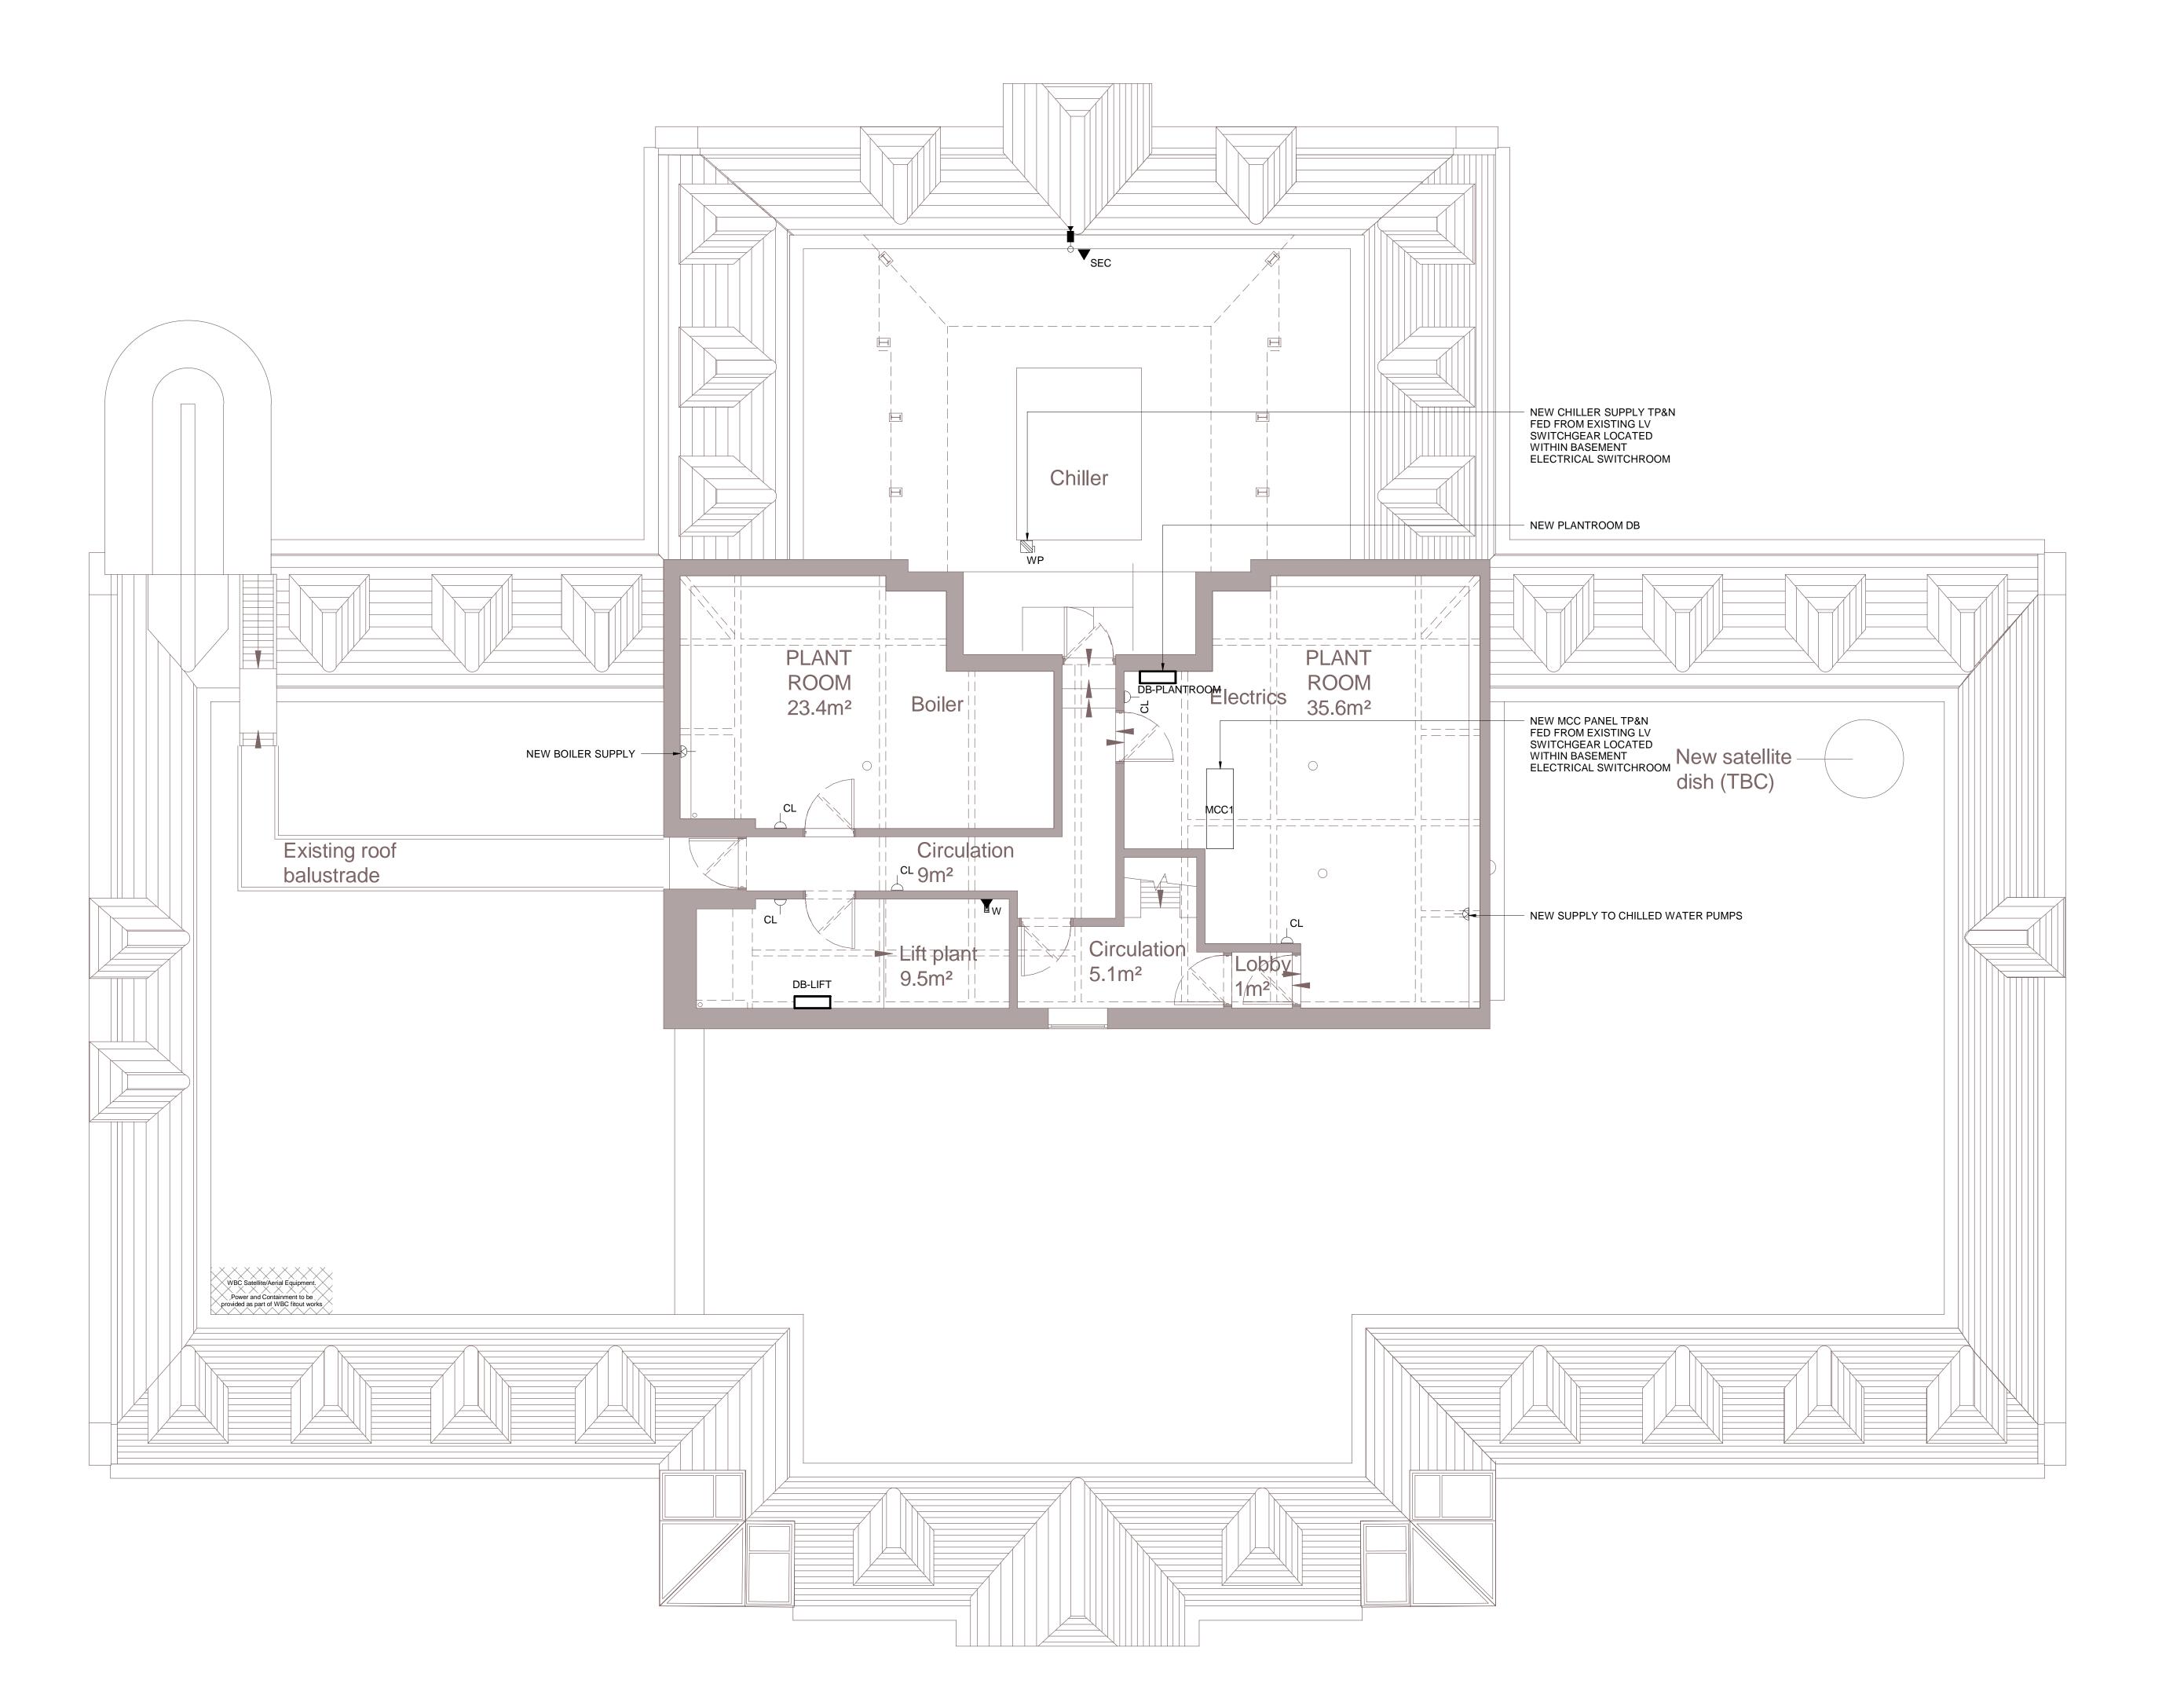

Watford Police Station Remodelling

**UK & IRELAND** Client

Hertfordshire Police and Crime Commissioner

Consultant

AECOM Aldgate Tower 2 Leman Street London E1 8FA United Kingdom Tel +44 (0) 20 7061 7000 www.aecom.com

SYSTEMS.

1. ALL SERVICES DRAWINGS TO BE READ IN CONJUNCTION WITH OTHER DISCIPLINE DRAWINGS, SCHEDULES AND SPECIFICATIONS. 2. DO NOT SCALE FROM THIS DRAWING. 3. SHOULD ANY DISCREPANCIES BE FOUND WITH THIS DRAWING AND ANY OTHER ASSOCIATED DRAWINGS/SPECIFICATIONS/REPORTS, THIS SHOULD BE BROUGHT TO THE ATTENTION OF ENGINEER IMMEDIATELY. 4. THIS DRAWING SHALL ONLY BE USED FOR THE SPECIFIC SERVICES INTENDED. 5. UNLESS OTHERWISE STATED, ALL MEASUREMENTS IN MILLIMETERS. 6. THE MEP SYSTEMS SHALL COMPLY WITH THE RELEVANT STANDARDS DESCRIBED IN THE SPECIFICATION.

7. LOCATIONS OF ALL SERVICE PROVISIONS ARE INDICATIVE. ALLOW FOR RELOCATIONS WITHIN A 2 METRE RADIUS. FINAL ACCESS AND SETTING OUT OF SERVICES TO BE AGREED WITH ARCHITECT. 8. ALL SOCKET OUTLETS SHALL BE LABELLED WITH THE APPROPRIATE CIRCUIT 9. ALL SOCKET OUTLETS SHALL BE
PROTECTED BY RCBO'S LOCATED IN THE
DISTRIBUTION BOARD UNLESS OTHERWISE 10. WBC FITOUT CONTRACTORS TO LIAISE WITH THE MAIN CONTRACTOR TO COORDINATE SERVICES ON THE ROOF AREA. EARTH AND LIGHTNING PROTECTION

BONDING IS TO BE PROVIDED BETWEEN THE SATELLITE/AERIAL EQUIPMENT AND EXISTING

Issue/Revision

**Suitability Status** 

S0 - Initial Status **Project Number** 

Small Power & Ancillaries Layout

**Sheet Number** 

Roof Layout

WPS-ACM-00-03-DR-EL-421005